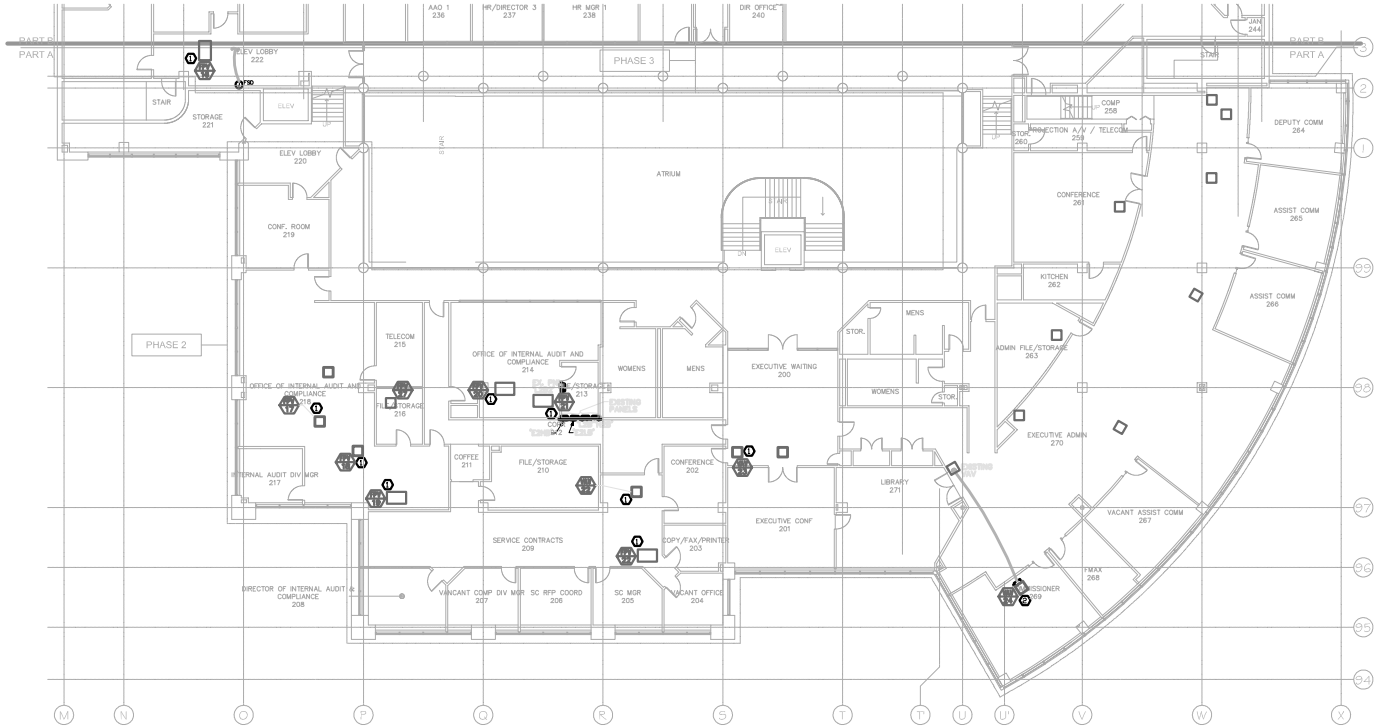

ELECTRICAL NOTES:

1. VAV BOX INDICATED TO BE RECONNECTED TO EXISTING CIRCUIT.
2. CONNECT VAV INDICATED TO NEAREST EXISTING VAV CIRCUIT AS SHOWN. PROVIDE 2 #12, 1 #12 GND., IN 3/4"C.

POWER - SECOND FLOOR PLAN - PART A

SCALE: 1/8" = 1'-0"

0 8 16 24 FEET

U.S. Thermoscan Manufacture Inc.

ICT

CONTROLS SYSTEMS
5400 POINT VIEW, SUITE 100
NASHVILLE, TENNESSEE 37211
PHONE (615) 334-0300
FAX (615) 334-0301
1-877-PROJECT-INC/TRACKER

ARCHITECTURE • INTERIOR DESIGN • PLANNING
5210 MARYLAND WAY SUITE E 200
BRENTWOOD, TN 37027
PHONE 615 377-9773
FAX 615 370-4427
WWW.TMPARTNERS.COM

THOMMI ASSOCIATES, PARTNERS

MILLER & PARTNERS

INTERIOR RENOVATIONS / ESSENTIAL MAINTENANCE PHASE
PIEDMONT GAS BUILDING
NASHVILLE, TN
SBC PROJ. No.
529/012-01-2009-01

POWER - SECOND FLOOR PLAN - PART A

DATE: 07/29/2011
JOB NO. 2009.00
DR. BY: Cadd
CK. BY: PM

REVISIONS:
A

E221A