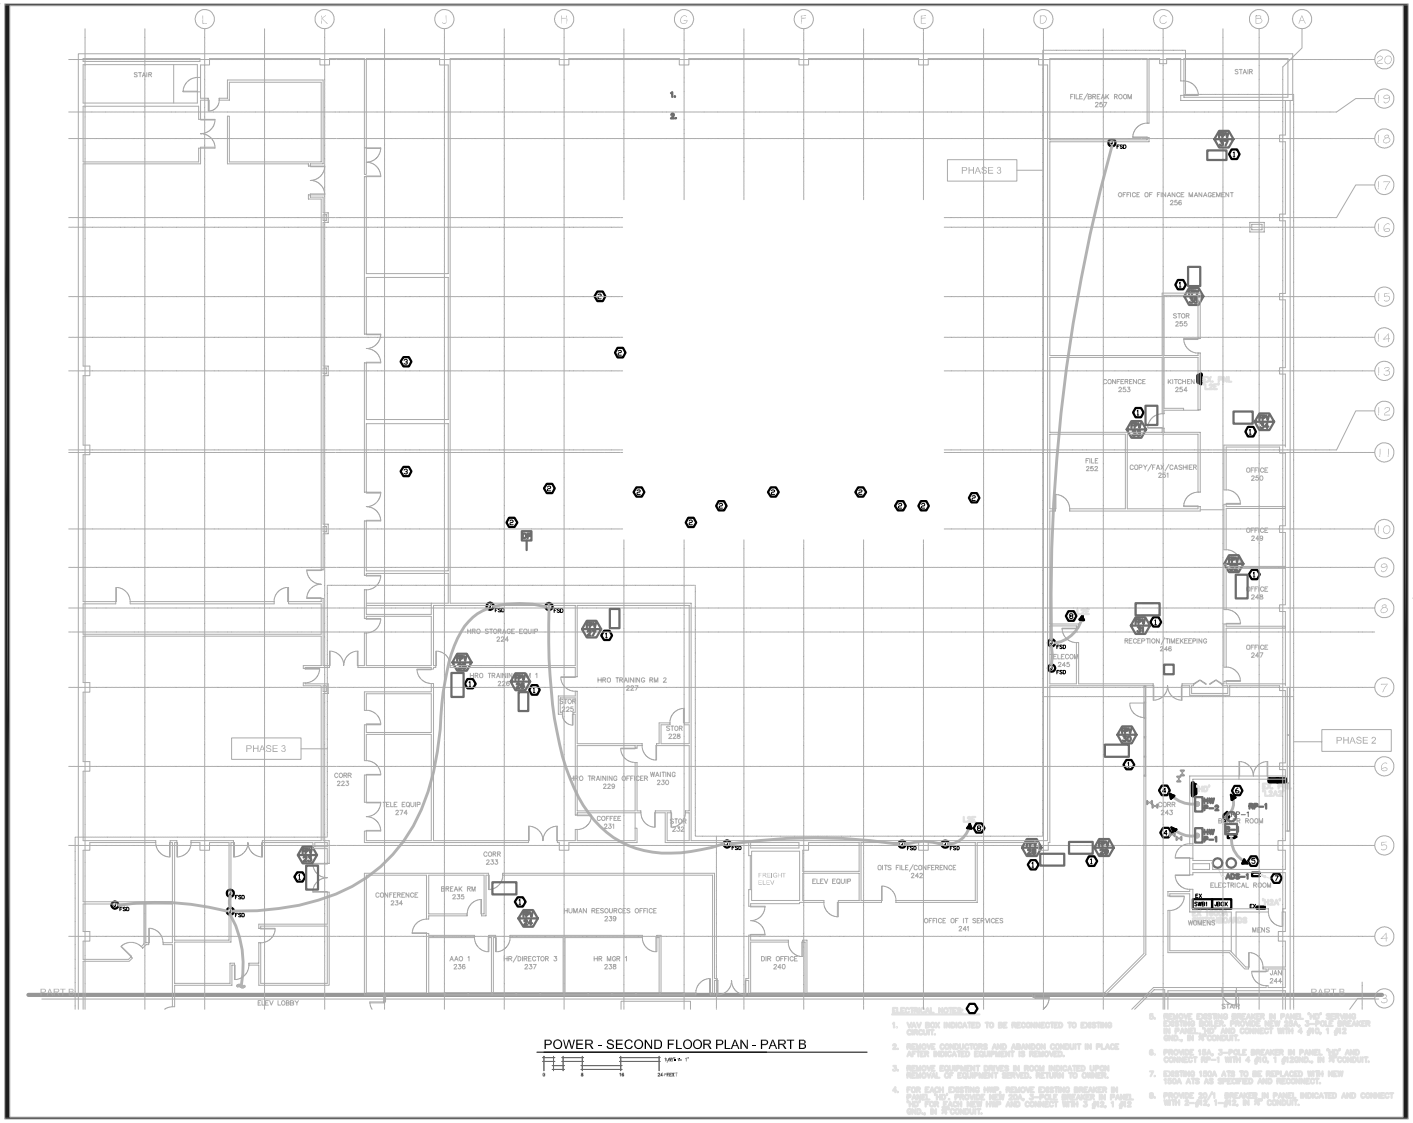

POWER - SECOND FLOOR PLAN - PART B

1/8" = 1'-0"

0 8 16 24 FEET

ELECTRICAL NOTES:

1. VAV BOX INDICATED TO BE RECONNECTED TO EXISTING CIRCUIT.
2. REMOVE CONDUITRS AND ABANDON CONDUIT IN PLACE AFTER INDICATED EQUIPMENT IS REMOVED.
3. REMOVE EQUIPMENT DRIVES IN ROOM INDICATED UPON REMOVAL OF EQUIPMENT BEHIND. RETURN TO OWNER.
4. FOR EACH EXISTING VAV, REMOVE EXISTING BREAKER IN PANEL "EV". PROVIDE NEW 20A, 2-POLE BREAKER IN PANEL "EP" FOR EACH NEW VAV AND CONNECT WITH 3 #12, 1 #12 GND., IN 1" CONDUIT.
5. REMOVE EXISTING BREAKER IN PANEL "EV" SERVING EXISTING FOUNTAIN BEYONDER AND PROVIDE NEW 20A, 2-POLE BREAKER IN PANEL "EP" AND CONNECT WITH 3 #12, 1 #12 GND., IN 1" CONDUIT.
6. PROVIDE 15A, 2-POLE BREAKER IN PANEL "EP" AND CONNECT RP-1 WITH 4 #10, 1 #10GND., IN 1" CONDUIT.
7. EXISTING 100A ATS TO BE REPLACED WITH NEW 100A ATS AS SPECIFIED AND RECONNECT.
8. PROVIDE 20/1 BREAKER IN PANEL INDICATED AND CONNECT WITH 2-#12, 1-#12, IN 1" CONDUIT.

INTERIOR RENOVATIONS / ESSENTIAL MAINTENANCE PHASE
PIEDMONT GAS BUILDING
NASHVILLE, TN
SBC PROJ. No.
529/012-01-2009-01

U.S. Thermoscan Inspection Inc.
CERTIFIED THERMOGRAPHERS
5408 MOUNT DARIS, SUITE 100
NASHVILLE, TENNESSEE 37211
PHONE (615) 834-0300
FAX (615) 834-0301
CT PROJECT No.110706-0

ICT

ARCHITECTURE INTERIOR DESIGN PLANNING

THOMMI & PARTNERS
ARCHITECTS, PLLC

5210 MARYLAND WAY SUITE 200 BRENTWOOD, TN 37027 PHONE 615 377-9773 FAX 615 370-4127 WWW.TMPARTNERS.COM

POWER - SECOND FLOOR PLAN - PART B

DATE: 07/29/2011
JOB NO. 14-0300.00
DR. BY: Cadd
CK. BY: PM

REVISIONS:
1 ADDENDUM
2 ADDENDUM

221B