



- REV. 4-13-11: ADJUSTED CROSSWALK MARKINGS, ADDED TYPE 2 SIDEWALK DIMENSION, MISC. EDITS TO DRAWING.
- REV. 5-8-13: REVISED TITLE FOR TERMINOLOGY.
- REV. 6-4-13: REVISED NOTE (C) AND (E), CHANGED TITLE.

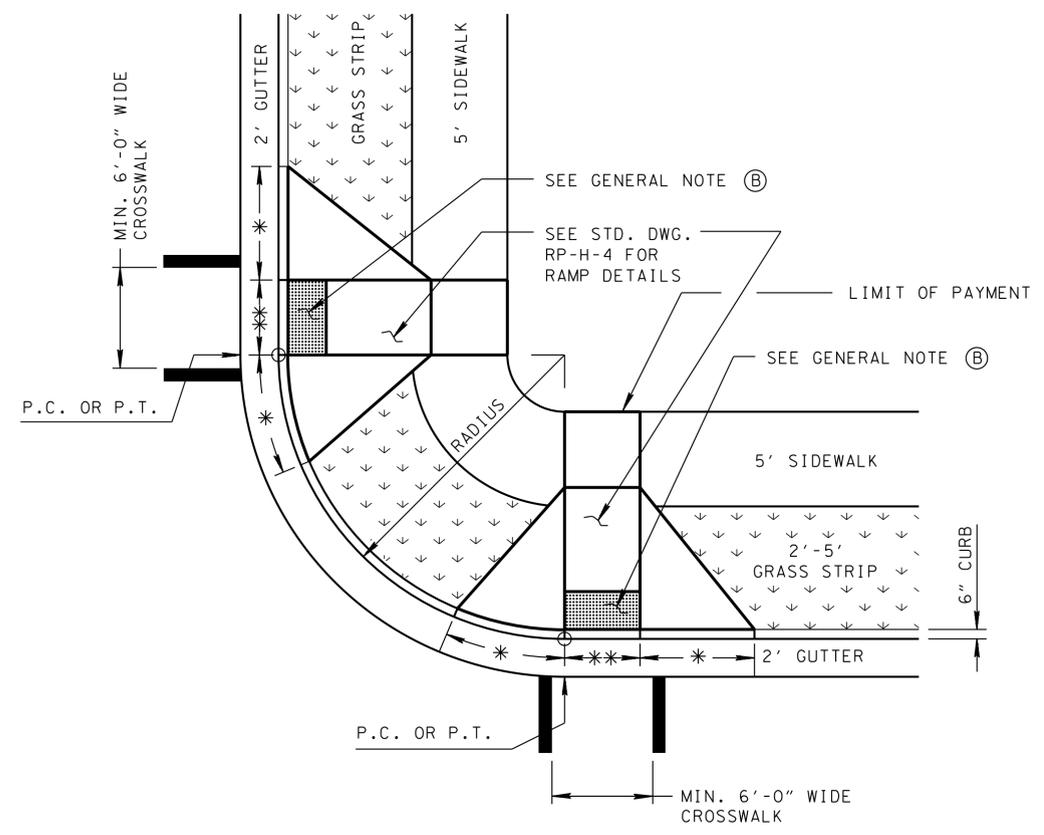

**TYPE 2  
RAMP OUTSIDE RADIUS (WITH GRASS STRIP)**

- \* DIMENSION VARIES RELATIVE TO LONGITUDINAL ROADWAY GRADE 10.0% MAX. (8.33% DESIRABLE)
- \*\* 4'-0" MINIMUM REQUIRED

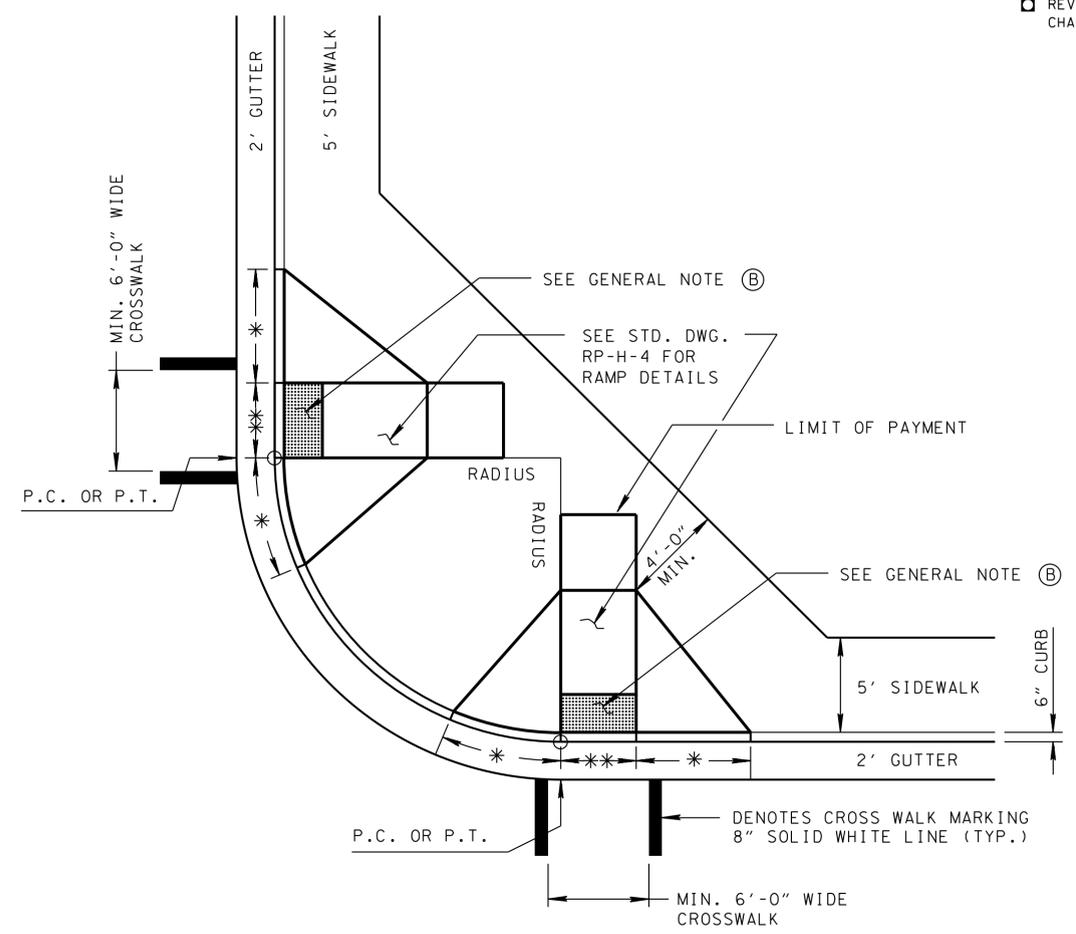

**TYPE 2 ALTERNATE  
RAMP OUTSIDE RADIUS (SIDEWALK ADJACENT TO CURB & GUTTER)**

- \* DIMENSION VARIES RELATIVE TO LONGITUDINAL ROADWAY GRADE 10.0% MAX. (8.33% DESIRABLE)
- \*\* 4'-0" MINIMUM REQUIRED

GENERAL NOTES	
(A)	FOR SIGNALIZED INTERSECTIONS THAT REQUIRE PEDESTRIAN SIGNAL PUSH BUTTONS, SEE TDOT TRAFFIC DESIGN MANUAL FOR PLACEMENT DETAILS.
(B)	SEE STANDARD DRAWING RP-H-3 FOR TRUNCATED DOMED SURFACE DETAILS.
(C)	5'-0" SIDEWALK WIDTH SHALL NOT INCLUDE 6" CONCRETE CURB.
(D)	GRATES FOR STORM DRAINS SHALL NOT BE PLACED IN THE CROSSWALK OR IN FRONT OF THE CURB RAMP.
(E)	DESIRABLE DIMENSIONS SHALL BE USED UNLESS OTHERWISE DIRECTED BY THE ENGINEER.

□ MINOR REVISION -- FHWA APPROVAL NOT REQUIRED.

STATE OF TENNESSEE  
DEPARTMENT OF TRANSPORTATION

PERPENDICULAR  
CURB RAMP  
TYPE 2