REFER TO THE PDS AMERICA SHEETS FOR ADA ACCESSIBLE CLEARANCE INFORMATION FOR DOORS, CASEWORK, SITE WORK AND PLUMBING FIXTURES

GENERAL FLOOR PLAN NOTES

2. ALLOW A MINIMUM OF 1 INCH CLEARANCE FROM THE EDGE OF ALL WALLS AND THE OUTSIDE FACE OF CASEWORK, TYPICAL

SEE DIMENSION PLAN FOR WALLS THAT REQUIRE SOUND ATTENUATION BLANKETS

AND/OR SPECIFIC SOUND WALL CONSTRUCTIONS.

SEE THE OWNER FURNISHED EQUIPMENT BROCHURE FOR SPECIFIC INFORMATION ON EACH PIECE OF OWNER FURNISHED EQUIPMENT SHOWN ON THE PLANS. ALSO SEE VENDOR DRAWINGS PROVIDED FOR POSSIBLE WORK REQUIRED FOR EACH SPECIFIC VENDOR EQUIPMENT. CONFIRM WORK REQUIRED FOR EACH PIECE OF

5. INDICATES VIEW WINDOW REQUIREMENTS. SEE WINDOW ELEVATIONS AND SCHEDULE FOR SIZES, GLAZING, ETC. REQUIRED.

EQUIPMENT BEFORE COMPLETING CONSTRUCTION FOR THOSE SPACES.

6. 188B INDICATES DOOR NUMBER. SEE DOOR SCHEDULE FOR SPECIFIC INFORMATION ON EACH DOOR.

7. SEE FINISH DRAWINGS FOR SPECIFIC FINISH AND SURFACE PREPARATION REQUIREMENTS FOR EACH SPACE.

SEE REFLECTED CEILING PLANS FOR SPECIFIC CEILING TYPES, HEIGHTS, DETAILS, LIGHTS, DIFFUSERS, ETC.

9. SEE CASEWORK DRAWINGS FOR SPECIFIC CASEWORK SIZES, FINISHES, AND OTHER REQUIREMENTS.

10. ALL CORRIDOR WALLS ARE TO BE SEALED TO LIMIT THE TRANSFER OF SMOKE (SMOKE RESISTIVE) REGARDLESS OF THE FIRE RATING ASSOCIATED WITH THE WALL.

11. ALL EXPANSION JOINTS THROUGH RATED ASSEMBLIES SHALL HAVE THE SAME FIRE RATING AS THE ASSEMBLY.

12. MOUNT BOTTOM OF TVS IN ALL ROOMS AT 80" A.F.F. MINIMUM UNLESS OTHERWISE NOTED. COORDINATE MOUNTING HEIGHTS W/ OWNER PRIOR TO INSTALLATION.

13. PROVIDE BLOCKING FOR LOCKERS, PROX. CABINETS, AND OTHER EQUIPMENT AS REQUIRED.

14. PROVIDE 6" METAL STUDS AT WATER CLOSET WET WALLS AND ALL BACK-TO-BACK PATIENT HEADWALLS, TYPICAL UNLESS NOTED OTHERWISE (U.N.O.).

15. PATCH AND REPAIR ALL EXISTING FIRE RATED WALLS WITHIN LIMITS OF WORK, TO MAINTAIN EXISTING OR NEW REQUIRED FIRE RATINGS.
 16. VERIFY RATING OF EXISTING PARTITIONS AND UPGRADE IF REQUIRED BY NEW

CONSTRUCTION.

17. SYMBOL INDICATES SPACE OR FEATURE HAS ACCESSIBILITY REQUIREMENTS. SEE ACCESSIBILITY DRAWINGS.

REQUIREMENTS, SEE ACCESSIBILITY DRAWINGS.

18. EXTERIOR WINDOWS MARKED WITH A O ARE SPANDREL GLASS PANELS WITH

CURTAIN WALL INSULATION. SEE EXTERIOR ELEVATIONS FOR LOCATIONS.

19. THE OWNER SHALL PROVIDE AND THE CONTRACTOR SHALL INSTALL THE FOLLOWING:

AT EACH SINK/LAVATORY LOCATION, ONE SOAP DISPENSER U.N.O. VERIFY LOCATION WITH OWNER'S REPRESENTATIVE.
 B. AT EACH PATIENT CARE, UTILITY AND WORK AREA, ONE SHARPS DISPOSAL UNIT, GLOVES DISPENSER, AND HAND GEL DISPENSER, AS DIRECTED BY OWNER. VERIFY LOCATIONS WITH OWNER'S REPRESENTATIVE.

20. FOR WALL/PARTITION LAYOUT, ALL INTERIOR PARTITIONS AND FIRE AND/OR SMOKE BARRIERS ARE DIMENSIONED TO THE CENTER LINE OF METAL STUDS. CHASES AND SHAFTWALLS ARE DIMENSIONED TO THE INSIDE FACE OF THE SHAFT. EXISTING WALLS ARE DIMENSIONED TO THE FINISHED FACE. ALL EXTERIOR WALLS ARE DIMENSIONED TO OUTSIDE FACE OF THE WALL SYSTEM. ALL CORRIDOR DIMENSIONS WILL BE FINISH TO FINISH CLEAR. (MINIMUM)

21. DIMENSIONS ARE TO BE COORDINATED WITH ALL CONSTRUCTION DISCIPLINES, VENDORS, OWNER FURNISHED EQUIPMENT AND OTHER DEVICES TO ASSURE PROPER PLACEMENT, MAINTENANCE ACCESS, VENTILATION AND WARRANTY REQUIREMENTS.

22. PROVIDE SOUND ATTENUATION BLANKET IN NON-RATED PARTITIONS AND FIRE AND/OR SMOKE PARTITIONS/BARRIERS AS REQUIRED BY SOUND WALL LEGEND (SEE FLOOR PLANS).

23. ELECTRICAL PANELS, FIRE HOSE CABINETS AND RECESSED OBJECTS OVER 16 SQUARE INCHES LOCATED IN FIRE PARTITIONS AND FIRE OR SMOKE BARRIERS ARE TO BE WRAPPED IN GYPSUM BOARD OR OTHER FIRESTOPPING MATERIAL TO MAINTAIN THE FIRE-RESISTIVE RATING AS REQUIRED BY APPROVED U.L. ASSEMBLIES. (SEE STANDARD DETAILS)

24. ALL GYPSUM BOARD ABUTTING OTHER MATERIALS SHALL BE FINISHED WITH METAL EDGES OR FIRE-STOPPED AS REQUIRED.

WALL LEGEND ALL WALL TYPES NOTED BELOW AS 30 MIN., 1, 2, 3 OR 4 HR. CARRY A FIRE RESISTANCE RATING

EXISTING NON-RATED PARTITION TO 4" ABOVE CEILING

EXISTING NON-RATED PARTITION TO DECK

EXISTING SMOKE PARTITION TO DECK

EXISTING 30-MINUTE FIRE PARTITION

EXISTING 1-HOUR RATED SHAFT WALL BARRIER

EXISTING 2-HOUR RATED SHAFT WALL BARRIER

EXISTING 1-HOUR FIRE BARRIER

EXISTING 1-HOUR SMOKE BARRIER

EXISTING 2-HOUR FIRE BARRIER

EXISTING 2-HOUR SMOKE BARRIER

EXISTING CAST-IN-PLACE CONC.

NON-RATED PARTITION TO 4" ABOVE CEILING

1-HOUR RATED SHAFT WALL BARRIER

2-HOUR RATED SHAFT WALL BARRIER

XXXXX

NON-RATED C.M.U. PARTITION TO DECK

SMOKE PARTITION TO DECK

1-HOUR FIRE BARRIER
1-HOUR SMOKE BARRIER

2-HOUR FIRE BARRIER

2-HOUR SMOKE BARRIER

CAST-IN-PLACE CONC.

2-HOUR CONC. FIRE BARRIER
2-HOUR CONC. SMOKE BARRIER

NON-RATED PARTITION TO DECK

EXISTING 2-HOUR CONC. FIRE BARRIER

EXISTING 2-HOUR CONC. SMOKE BARRIER

## CODE LOCK SET PANIC DEVICE DEADBOLT PASSAGE SET HARDWARE BY OTHERS PDT PASSAGE WITH DUMMY TRIM HLAT HOSP. LATCHSET HOC HOSP. LOCKSET PRIVACY SET INSTITUTIONAL SET STOREROOM SET NO ENTRY SET DOOR ACCESS CONTROL LEGEND AUTOMATIC DOOR KS KEY SWITCH MULTI DOOR LOCK DB DOOR BELL DC DOOR CONTACT MS MOTION SENSOR ELECTRIC LATCH RELEASE PB PANIC BUTTON ELECTROMAGNETIC LOCK PBR PUSH BUTTON RELEASE EDD ELECTRIC PANIC DEVICE PCL PROX CARD LOCKSET -SECURITY CONNECTION ELECTRIC PANIC DEVICE FAILSAFE PCLS PROX CARD LOCKSET -ELECTRIC PANIC DEVICE STAND ALONE W/ INTEGRAL KEY PAD PROX CARD LOCKSET - WIFI ELECTRIC PANIC DEVICE W/ SECURITY CONNECTION INTEGRAL PROX P.E.T. PANIC w/ ELECT. TRIM ERS EMERGENCY RELEASE SWITCH PP PUSH PAD ES ELECTRIC STRIKE PROX CARD READER - IN WALL HOLD OPEN - ELECTROMAGNETIC PS PRESENCE SENSOR INTERCOM INTERCOM - VIDEO REQUEST TO EXIT SECURITY INTERFACE INFANT SECURITY SYSTEM KP KEY PAD SAFE ZONE CLOSER KPL KEY PAD LOCKSET WP WAVE PAD

OFF -

OFFICE SET

DOOR / HARDWARE FUNCTION LEGEND

CLASSROOM SET

CLR -

## PLAN KEY NOTES

PROVIDE INTEGRAL LOUVER BLIND WINDOW UNITS W/ TURN KNOB ON INTERIOR FACE OF OF EXISTING EXTERIOR WINDOW ASSEMBLY. FIELD VERIFY ROUGH OPENING REQUIREMENTS AND DIMENSIONS. MATCH EXISTING LOUVER FINISH.

BASIS OF DESIGN: WAUSAU 1297 W/ 1" BETWEEN GLASS VENETRIAN BLINDS W/ SLIP-CLUTCH TILT CONTROL KNOB AND CONCEALED RAISE-LOWER CONTROLS. MATCH EXISTING LOUVER COLOR.


EXTEND TOP OF WALL ABOVE CEILING LEFT OPEN FOR VENTING. PROVIDE OPAQUE SPANDREL FILM TO EXISTING EXTERIOR STOREFRONT GLAZING.

COORDINATE EXISTING OWNER PROVIDED EQUIPMENT TO BE RELOCATED.

4 COORDINATE CEILING & SUPPORT FOR PATIENT LIFTS PER VENDOR REQUIREMENTS, TYP.

5 DOWNGRADE EXISTING WALLS FROM 2-HR SMOKE RATING AS INDICATED ON PLANS.

UPGRADE EXISTING WALL RATING AS INDICATED ON PLANS.

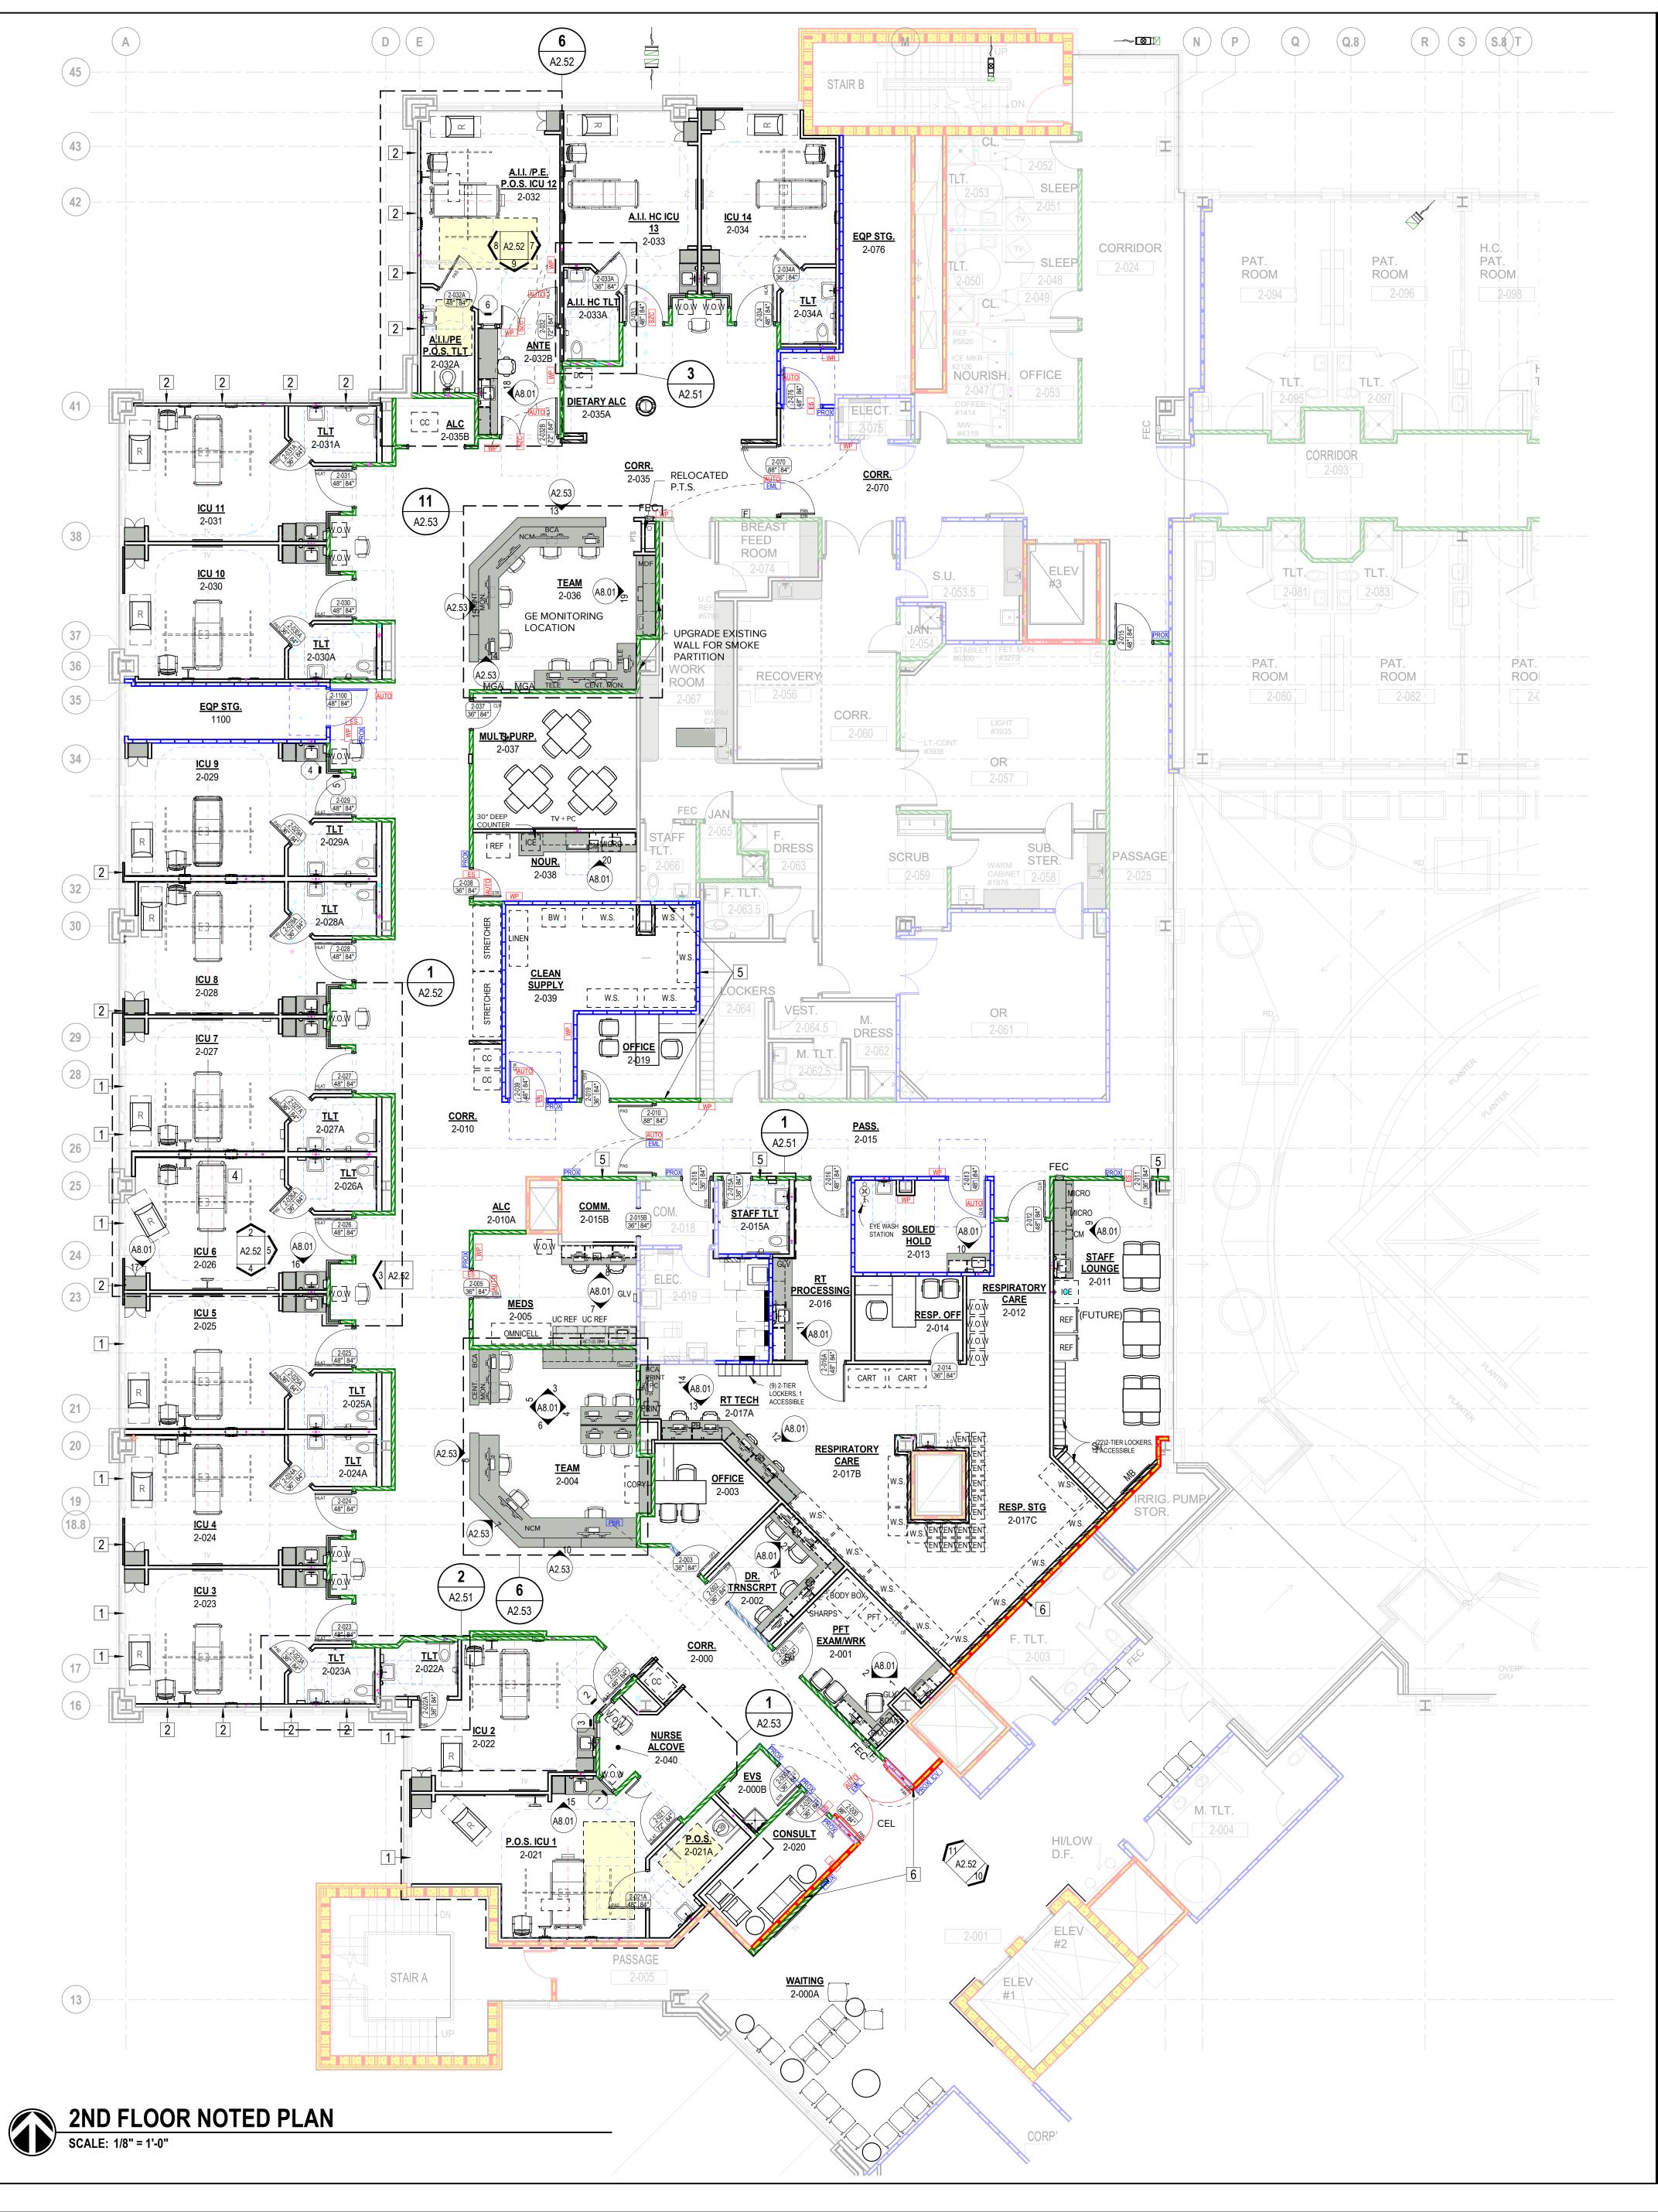

Earl Swensson Associates, Inc.

1033 Demonbreun Street
Suite 800
Nashville, Tennessee 37203
615-329-9445

This drawing and the design shown is the property of the architect. The reproduction, copying or use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.

© Earl Swensson Associates. Inc. 2023

Seals



SAPTIST MEMORIAL HOSPITAL COLLIER

2ND FLOOR NOTED PLAN

A1.02N