

TYPICAL SIDEWALK CROSS SECTION

LEAVE SQUARE OPENING IN SIDEWALK. THE LENGTH OF THE SIDE OF THE SQUARE OPENING SHOULD BE EQUAL TO THE DIAMETER OF THE FIXED OBJECT PLUS SIXTEEN INCHES, IT WILL BE BORDERED BY HALF INCH EXPANSION JOINT.

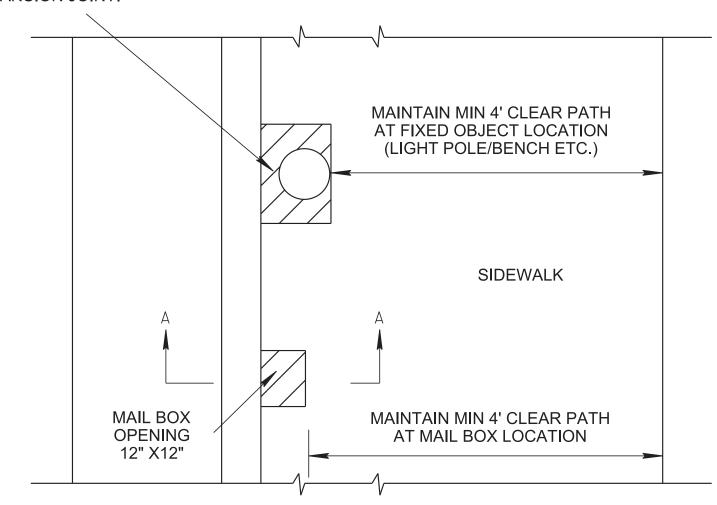

SIDEWALK CONSTRUCTION DETAILS PLAN VIEW

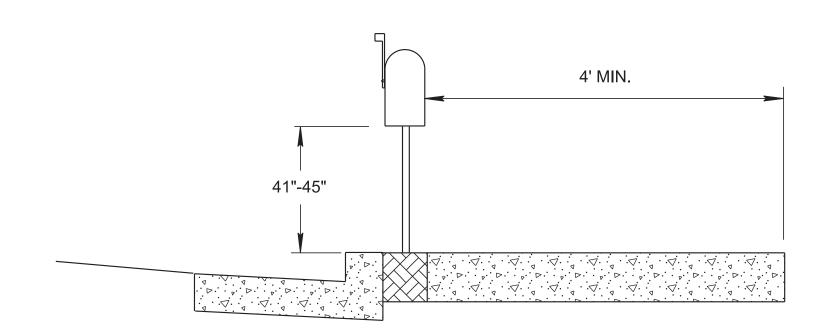

SECTION A-A MAIL BOX DETAIL

LEAVE 12"X12" OPENING IN SIDEWALK FOR MAIL BOX POST. ORIENT BOXES TO FACE THE DIRECTION OF ONCOMING TRAFFIC. EDGE OF MAIL BOX SHALL NOT OVERHANG BEYOND THE FACE OF THE CURB. NOR SHALL THE MAIL BOX OVERHANG THE SIDEWALK SUCH THAT THE USABLE WIDTH IS LESS THAN 4 FEET.

TYPICAL SIDEWALK CROSS SECTION WITH GRASS STRIP

1/4" RADIUS ON CORNER 4" MIN DETAIL OF EXPANSION JOINT

EXPANSION JOINT DETAIL

REFERENCED STANDARD DRAWINGS

SEE T-M-4 FOR CROSS WALK MARKING

SEE RP-H-SERIES FOR CURB RAMP DETAILS

SEE S-BPR-1 FOR PEDESTRIAN RAIL REQUIREMENTS

SEE RP-S-9 FOR ALTERNATE DETAILS

FOR PEDESTRIAN FACILITIES FOR REHABILITATION PROJECTS

SEE RP-SC-1 FOR 6" SLOPING CONCRETE CURBS AMD

CONCRETE CURBS AND GUTTERS

SEE RP-VC-10 OR 11 FOR VERTICAL CONCRETE CURB AND CONCRETE CURBS AND GUTTER DETAILS

SEE T-M-10, 11, 12, 13, 14, FOR BIKE LANE/ROUTE PAVEMENT

MARKINGS

SEE RD01-TS-8 FOR SHARED USE PATH DETAILS

SEE S-PL-6 FOR GUARDRAIL PLACEMENT

GENERAL NOTES

- ALWAYS PLACE SIDEWALK AS FAR AS AWAY FROM THE TRAVELLED WAY WHEN POSSIBLE FOR SPECIFICATIONS SEE "STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION" OF THE TENNESSEE DEPARTMENT OF TRANSPORTATION.
- B WHERE IT BECOMES NECESSARY TO REMOVE PARTS OF EXISTING CONCRETE SIDEWALKS OR RAMPS, THE RESULTING EDGES SHALL BE CUT TO A NEAT LINE, AND ANY OFFSETS IN SUCH LINES SHALL BE MADE OFFSETS IN SUCH LINES SHALL BE MADE AT RIGHT ANGLES.
- © SIDEWALK WIDTHS DO NOT INCLUDE THE SIX INCH CURB WIDTH OF PROPOSED TOP OF CURB.
- (D) DESIREABLE SIDEWALK CROSS SLOPE IS 1.5 %, ABSOLUTE MAXIMUM IS 2.0 %.

CONSTRUCTION NOTES

- EXPANSION JOINTS ARE TO BE PLACED 25 TO 30 FEET APART DEPENDING ON TRANSVERSE JOINT MARKINGS AND NEED TO MATCH CURB EXPANSION JOINT WHERE SIDEWALK IS BUILT DIRECTLY AGAINST CURB, OR AS DIRECTED BY THE ENGINEER WHERE THE PROPOSED SIDEWALK IS IN CONTACT WITH THE STREET RETURNS, ON BUILDING LINES PRODUCED AT STREET INTERSECTIONS, WHERE WALKS LEAD TO HOUSE OR OTHER ENTRANCES AND ANY OTHER LOCATIONS WHERE STRESSES MAY DEVELOP. THE COST OF ALL EXPANSION JOINTS IS TO BE INCLUDED IN THE UNIT PRICE BID FOR THE PROPOSED SIDEWALK.
- CONCRETE JOINT MATERIAL TO BE FLUSH WITH THE SIDEWALK SURFACE, HALF INCH AND/OR ONE INCH PREMOLDED FIBER IN ACCORDANCE WITH SECTION 905 OF THE STANDARD SPECIFICATIONS
- G ONE INCH EXPANSION JOINTS ARE TO BE PLACED WHERE THE PROPOSED SIDEWALK IN CONTACT WITH CIRCULAR CURBS, BUILDINGS AND/OR RETAINING WALLS.
- (H) HALF INCH EXPANSION JOINTS ARE TO BE USED AT ALL OTHER LOCATIONS
- I) LONGITUDINAL JOINT MARKINGS WILL NOT BE REQUIRED ON SIDEWALKS 5 FEET LESS IN WIDTH.
- J) ONE LONGITUDINAL JOINT MARKING WILL BE REQUIRED ON SIDEWALKS OVER 5 FEET BUT LESS THAN 9 FEET IN WIDTH.
- (K) TWO LONGITUDINAL JOINT MARKINGS WILL BE REQUIRED ON SIDEWALKS OVER 9 FEET BUT LESS THAN 12 FEET IN WIDTH.
- TRANSVERSE JOINT MARKINGS ARE TO BE MADE TO FORM BLOCKS AS NEARLY TO SQUARE AS PRACTICAL.

REV. 7-1-72: CHANGED DEPARTMENT NAME.

JOINTS BETWEEN CURB AND SIDEWALK.

REV. 1-1-76: CHANGED DWG. NO. FROM P-S-7A(68)TO RP-S-7.

REV. 5-14-87: ADDED EXPANSION

REV. 4-15-91: REDREW, RENAMED AND REORGANIZED SHEET. MOVED INFORMATION REGARDING CONCRETE STEPS TO DWG. NO. RP-S-8.

■ REV. 7-29-96: CHANGED GENERAL NOTE ⑤.

■ REV. 5-7-13: ADDED MAIL BOX DETAIL.

REV. 6-4-13: REVISED NOTES C AND (G) AND ADDED NOTE (L).

■ REV. 11-25-13: REVISED NOTE ②.

REV. 2-5-16: REDRAWN, REVISED

REV. 05-15-18: MODIFIED TYPICAL CROSS SECTION. CHANGED REFERENCED STD. DWG FROM RP-NMC-10 AND RP-NMC-11 TO RP-VC-10 AND RP-VC-11.

MINOR REVISION -- FHWA APPROVAL NOT REQUIRED

STATE OF TENNESSEE
DEPARTMENT OF
TRANSPORTATION

DETAILS FOR CONCRETE SIDEWALK

01-19-96

RP-S-7

NOT TO SCALE